Exh. Petitioner EJM-5

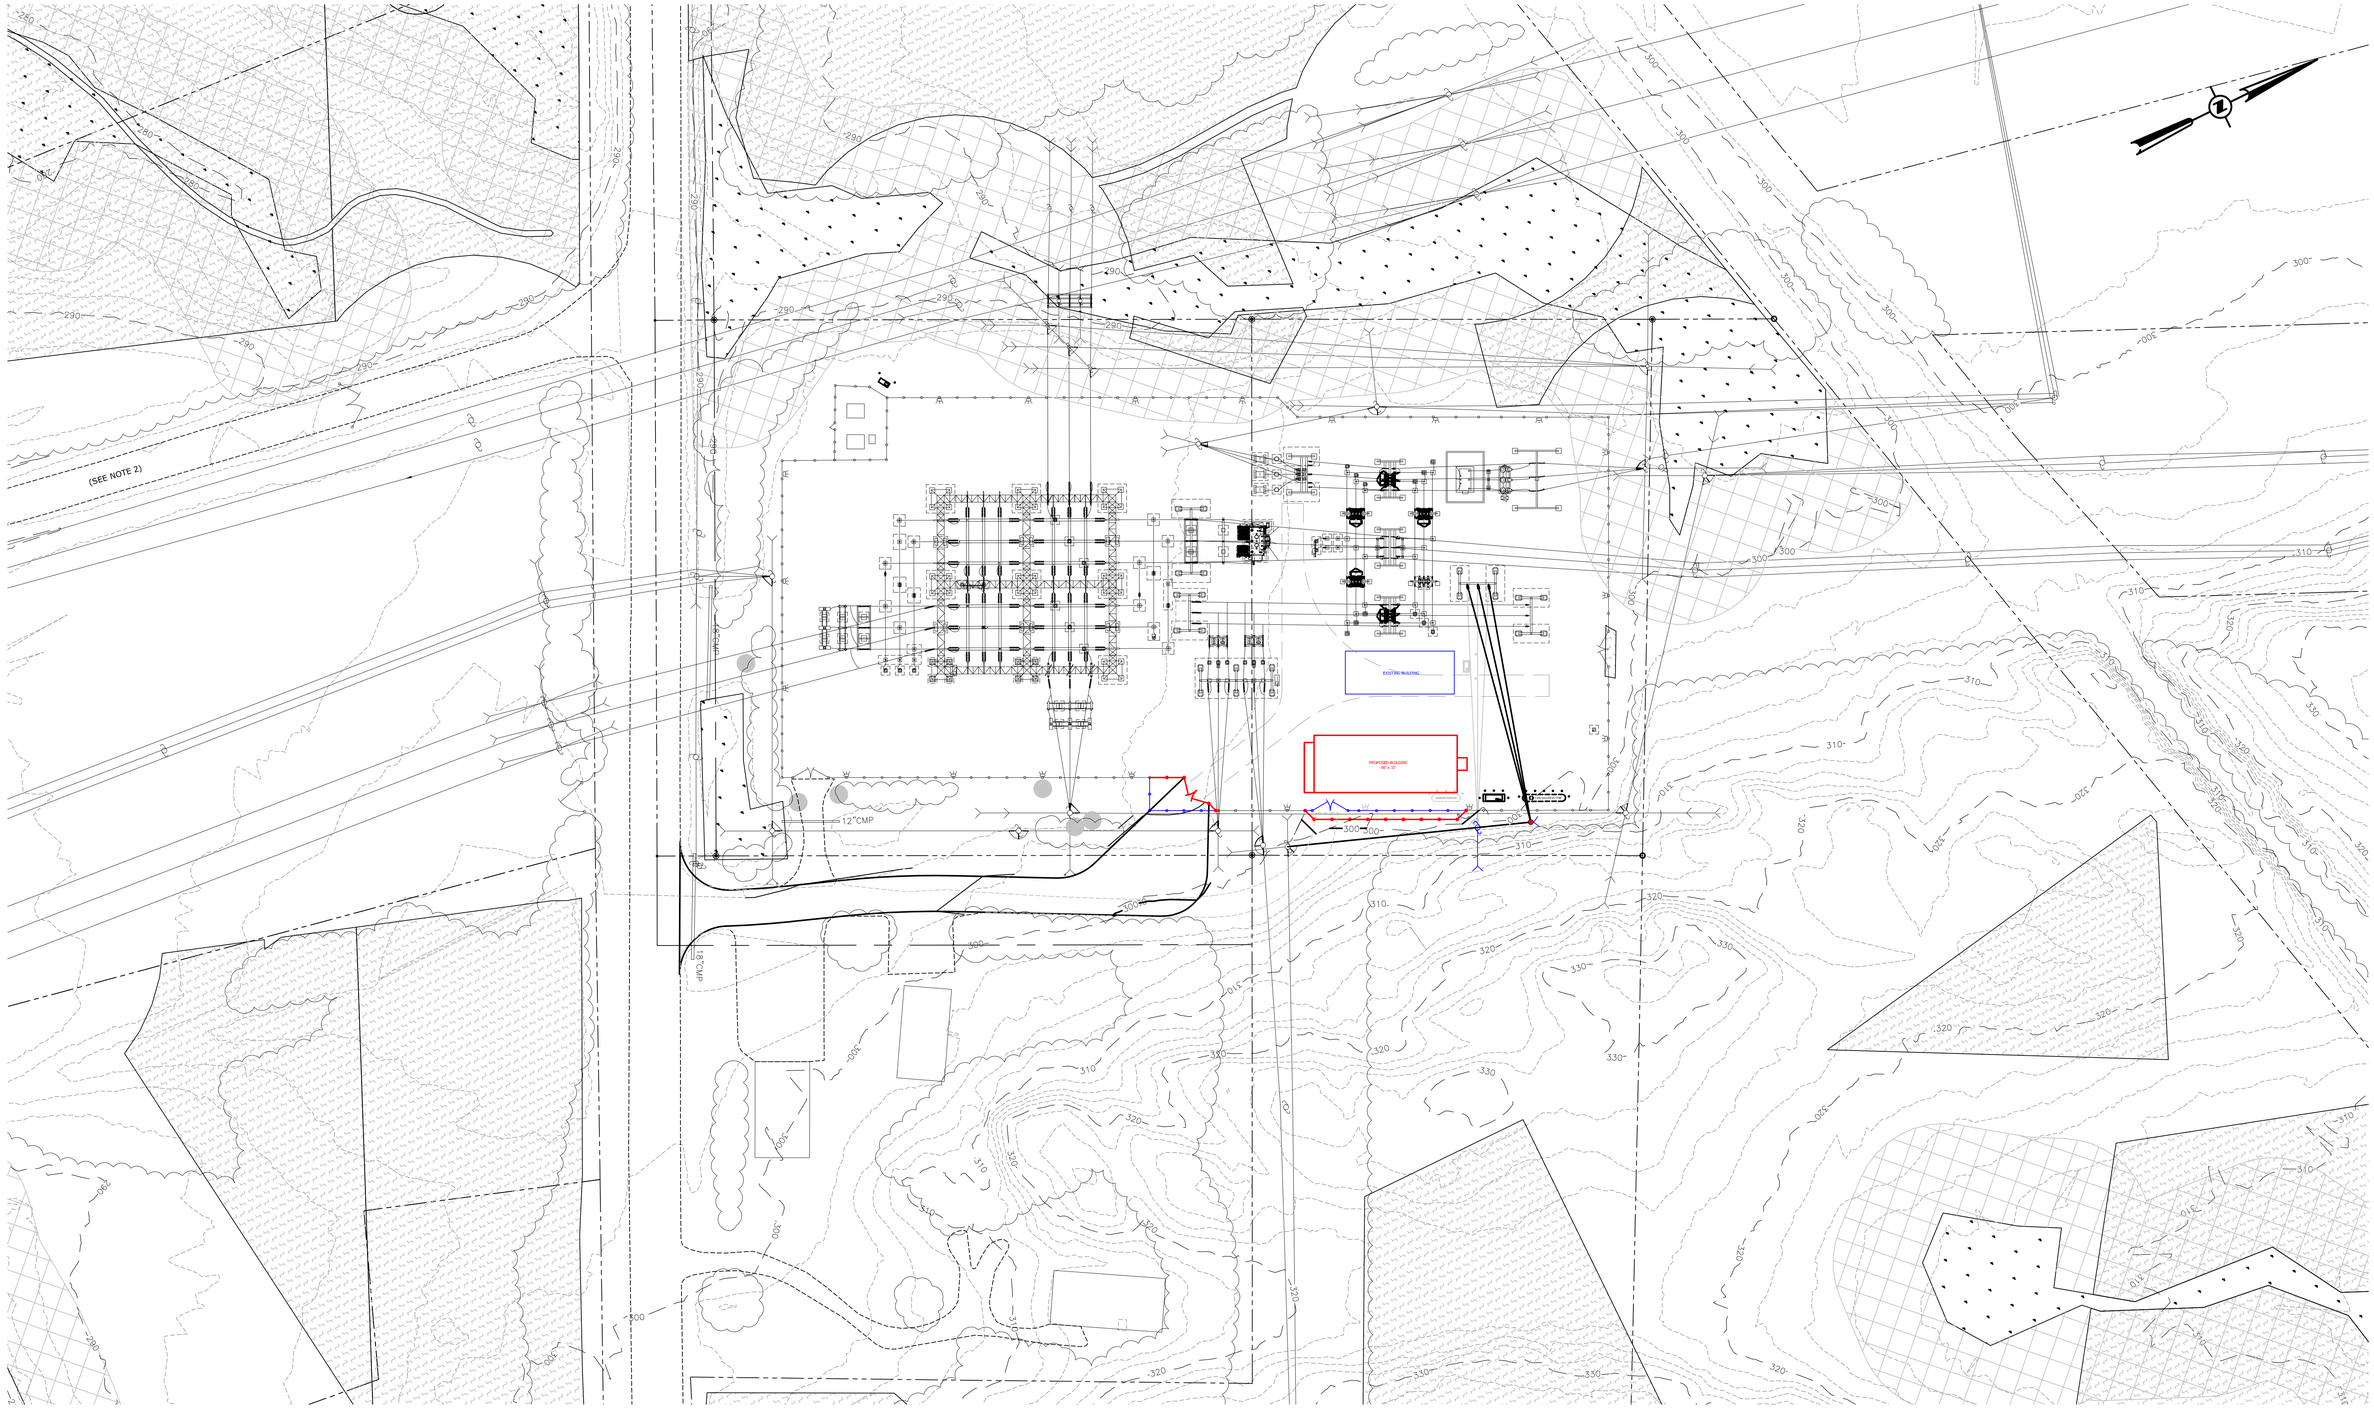

AS REQUIRED BY 30 V.S.A. § 7004, NO PERSON SHALL ENGAGE IN EXCAVATION ACTIVITIES WITHOUT FIRST GIVING AT LEAST FORTY-EIGHT (48) HOURS NOTICE TO DIGSAFE. DIGSAFE HAS NOT MARKED THE ELECTRIC LINES AND/OR LOCATION OF ANY UNDERGROUND UTILITIES.

CALL 811

COLOR KEY

- EXISTING INFRASTRUCTURE TO REMAIN
- EXISTING INFRASTRUCTURE TO BE REMOVED
- PROPOSED OR RELOCATED INFRASTRUCTURE

LEGEND

- SUBSTATION FENCE
- EXISTING YARD LIGHT
- EXISTING UTILITY POLE
- EXISTING UTILITY POLE ANCHOR
- PROPOSED UTILITY POLE
- APPROXIMATE BOUNDARY LINE
- APPROXIMATE ROW LINE
- EXISTING TREELINE
- 330 PROPOSED 10' CONTOUR
- PROPOSED 2' CONTOUR
- 330 EXISTING 10' CONTOUR
- EXISTING 2' CONTOUR
- WETLAND
- WETLAND BUFFER
- ARCHAEOLOGICALLY SENSITIVE AREA
- ENVIRONMENTAL RTE

GENERAL NOTES:

1. THIS PLAN DOES NOT CONSTITUTE A BOUNDARY SURVEY.
2. ADDITIONAL CONSTRUCTION PARKING AVAILABLE AT THE HIGHGATE CONVERTER (NOT SHOWN ON THIS PLAN).
3. RTE POPULATIONS ARE TO BE FLAGGED, BARRICADED AND AVOIDED DURING CONSTRUCTION.

40 0 40 80 120 160

REV	DATE	DR	CK	DESCRIPTION
0	08.09.22	JJO	JWK	ISSUED FOR PERMIT

VELCO

VERMONT ELECTRIC POWER CO., INC.
RUTLAND, VERMONT

HIGHGATE SUBSTATION

OVERALL SITE PLAN
115/46 kV YARD

SCALE: AS SHOWN | DRAWN BY: JJO | APPROVED BY:
DATE: 08/09/22 | CHECKED BY: JWK | DATE
SHEET NUMBER: 272-6100D | REV.

FILE: